
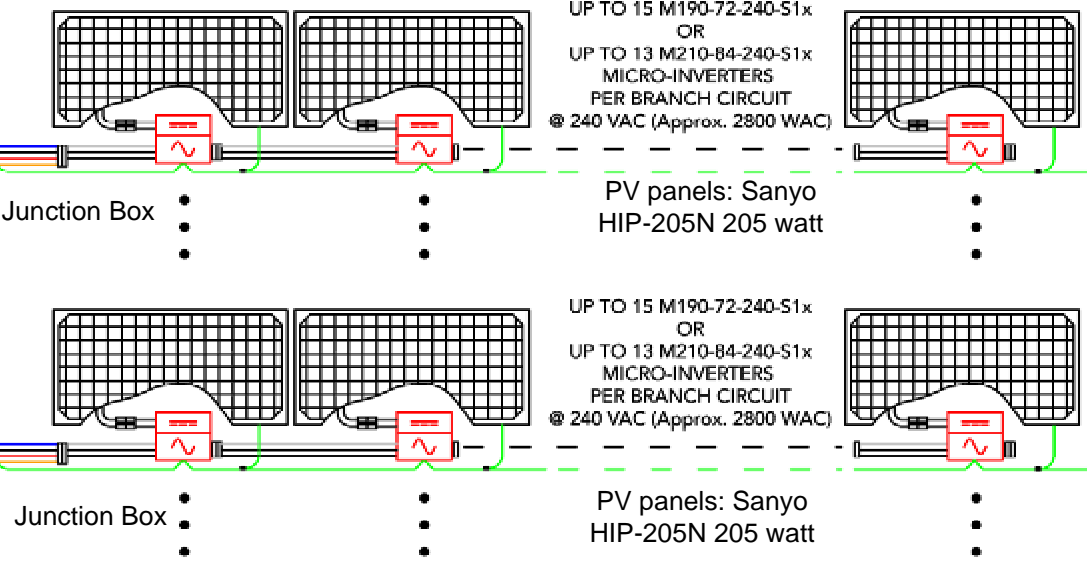


Utility Company Safety Disconnect Switches
2 pole 30 Amp NEMA 3R

Typical #12-8 AWG THHN-2 in conduit

Typical #12-8 AWG THHN-2 in conduit

1 - 2 POLE 15 AMP CIRCUIT BREAKER PER BRANCH CIRCUIT

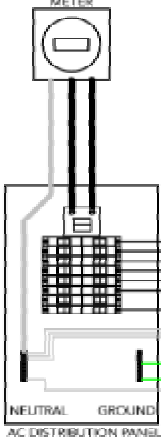

Uniform Circular Motion, LLC DBA Sun Volt Solar 30 Sherman Road Kerhonkson, NY 12446 (845) 626-2627		3 Line Diagram, Photovoltaic System w/Enphase M210 inverters			
		240 VAC Single Phase 20 ea Enphase M210-84-240-S12 inverters 20 ea Sanyo HIP-205N PV panels 4,100 watts nominal			
SIZE	FSCM NO	DWG NO		REV	
	0	11/09		0	
SCALE	None	P.Thurst	SHEET	1 OF 1	